



N:\CAD Data\Standard Dwgs\Sanitary Sewer Details\SS-2.7_Cleanout.dwg, 3/28/2007 2:39:28 PM

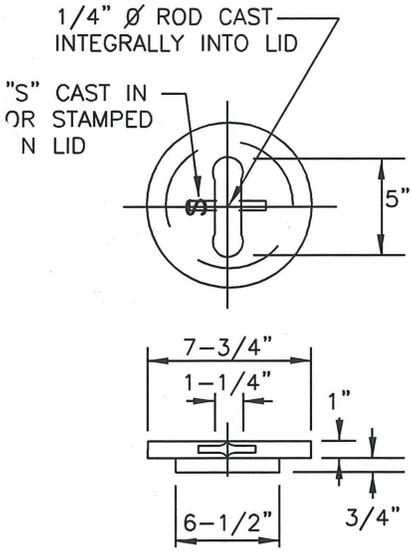


COVER

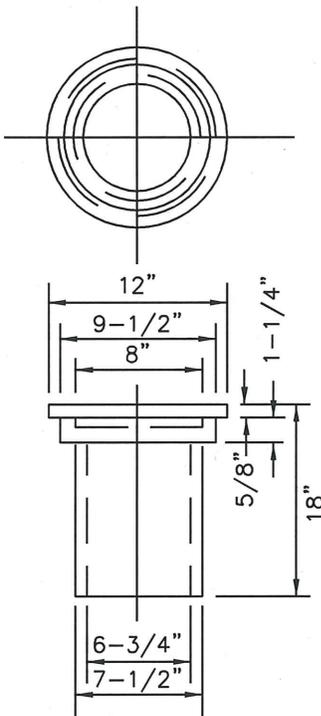

CAST IRON VALVE BOX AND COVER NO. 910

CONCRETE ANCHOR REQUIRED ON UNIMPROVED SURFACE
 CAST IRON VALVE BOX & COVER
 MATCH A.C. OR P.C.C. DEPTH (3" MIN.)
 PAVED SURFACE

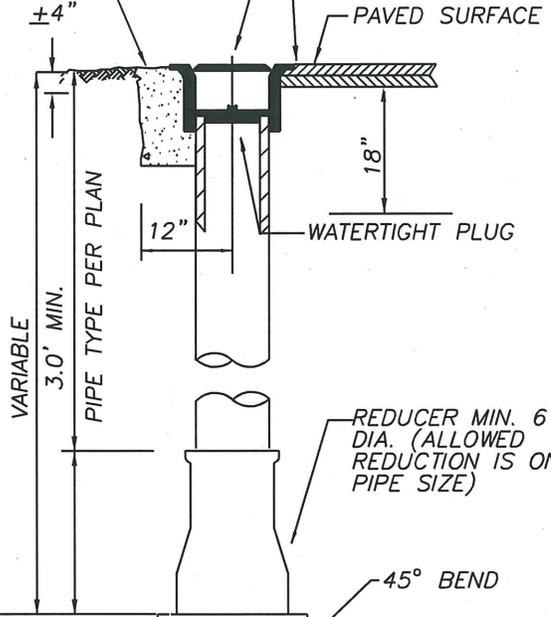

MATERIAL TO BE GREY CAST IRON CONFORMING TO ASTM A-46 CLASS 30

NOTE: TOLERANCE = 1/8"

NOTE: CLEANOUT TO BE 8" Ø

45° BEND

UNDISTURBED NATIVE MATERIAL

3000 PSI CONCRETE, 2-4 INCH SLUMP
 PIPE TO BE CONCRETE ENCASED ALL AROUND

4" MIN.

1:2 MAX

SEWER CLEANOUT

VALVE BOX SHALL BE FORT VANCOUVER
 PATTERN NO. 910 CAST IRON OR APPROVED EQUAL

STANDARD SEWER CLEANOUT

PLAN #



CITY OF BATTLE GROUND APPROVED

John Adams 3-29-07
 CITY ENGINEER DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	8/12/98	BSG	GGH
2	8/30/05	ALL	MCH
3	3/28/07	JMH	MCH

SS-2.7