


NOTES:

1. SUBGRADE GEOTEXTILE FABRIC GTF-200 OR APPROVED EQUAL SHALL BE INSTALLED OVER SOILS PRIOR TO CONSTRUCTING THE BASE AND SURFACING.
2. ASPHALT CONCRETE FOR ALL ROADS SHALL BE WSDOT CLASS A, PLACED IN LIFTS, AS SPECIFIED IN THE STANDARD SPECIFICATIONS. TIMING OF EACH LIFT SHALL BE APPROVED BY CITY ENGINEER.
3. ASPHALT SHALL HAVE A MINIMUM THICKNESS OF 3.6 INCHES (0.30 FEET) AND THE BASE ROCK SHALL HAVE A MINIMUM THICKNESS OF 9.6 INCHES (0.80 FEET). THESE MINIMUMS DO NOT RELIEVE THE ENGINEER OF DETERMINING THE APPROPRIATE THICKNESSES.
4. ROAD CONSTRUCTION BETWEEN OCTOBER 1 AND APRIL 1 SHALL REQUIRE A WET WEATHER PLAN. PLAN SHALL BE SUBMITTED TO THE CITY INSPECTOR.
5. THE APPLICABLE WSDOT STANDARD SPECIFICATIONS APPLY TO PAVING IN THE CITY OF BATTLE GROUND.
6. STREET LIGHTING, SIGNING, LANDSCAPING, AND WATER METERS SHALL BE INSTALLED IN THE PLANTER STRIP.

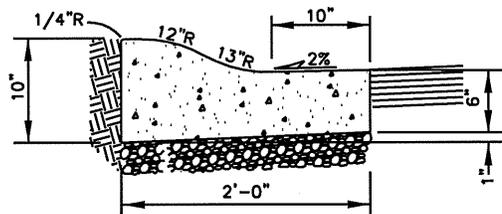

ROLLED CURB AND GUTTER
 USE OF ROLLED CURB AND GUTTER PERMITTED IN CUL-DE-SAC BULBS
 ROAD MODIFICATION REQUIRED FOR OTHER USES.

N.T.S.

ALLEY - ONE-WAY

PLAN #



CITY OF BATTLE GROUND
 APPROVED

Rb
 5/31/08
 CITY ENGINEER DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	1/31/08	JMH	MCH
2	5/31/08	JMH	MCH

TR-2.10