


SECTION A-A

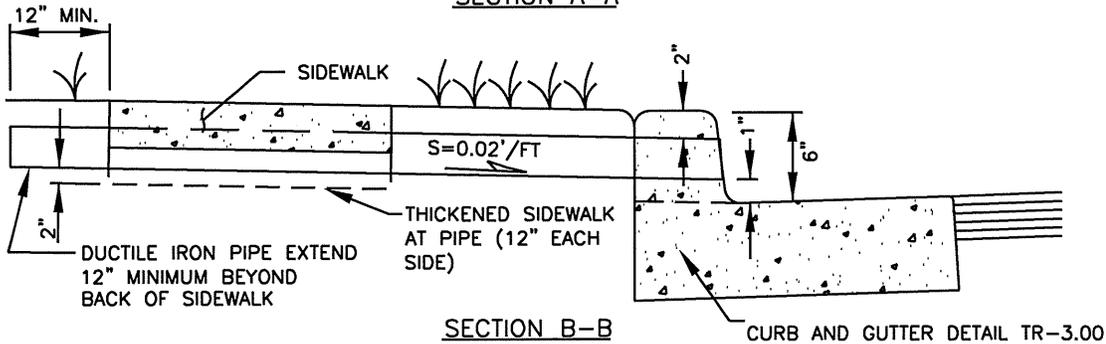

SECTION B-B


**NOTE:**

1. WHEN CURB DRAINS ARE USED, DRAINAGE FACILITIES MUST BE SIZED FOR BOTH QUANTITY AND QUALITY STORM WATER TREATMENT.
2. FINISH PIPE END FLUSH WITH FACE OF CURB.
3. GROUT ANY VOIDS IN CONCRETE SURROUNDING PIPE.
4. SHOW LOCATION ON PLAN TO AVOID CONFLICT'S WITH STREET LIGHTS, WATER METERS AND OTHER UTILITIES.
5. CURB DRAINS NOT ALLOWED IN ROLLED CURBS. PRIVATE DRAINAGE SYSTEMS IN FRONT YARD OR BACK YARD REQUIRED.
6. WHOLE PANEL MUST BE REPLACED AFTER INSTALLATION.

N.T.S.

## CURB DRAIN

PLAN #



CITY OF BATTLE GROUND  
APPROVED

Rl W

6/2/08

CITY ENGINEER      DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	1/31/08	JMH	MCH
2	6/2/08	JMH	MCH

TR-3.03