


NOTES:


1. SIDEWALK SLOPE TO BE 2% MAX. RADIALLY AROUND CORNER SECTION.
2. APPLY HEAVY BROOM FINISH ON ALL SLOPES GREATER THAN 2%.
3. PRECAST TRUNCATED DOMES REQUIRED ON ALL CURB RAMPS, PER DETAIL TR-4.04.
4. RAMPS SHALL HAVE A BRUSHED TEXTURE SURFACE APPLIED TO THE STILL FRESH CONCRETE.

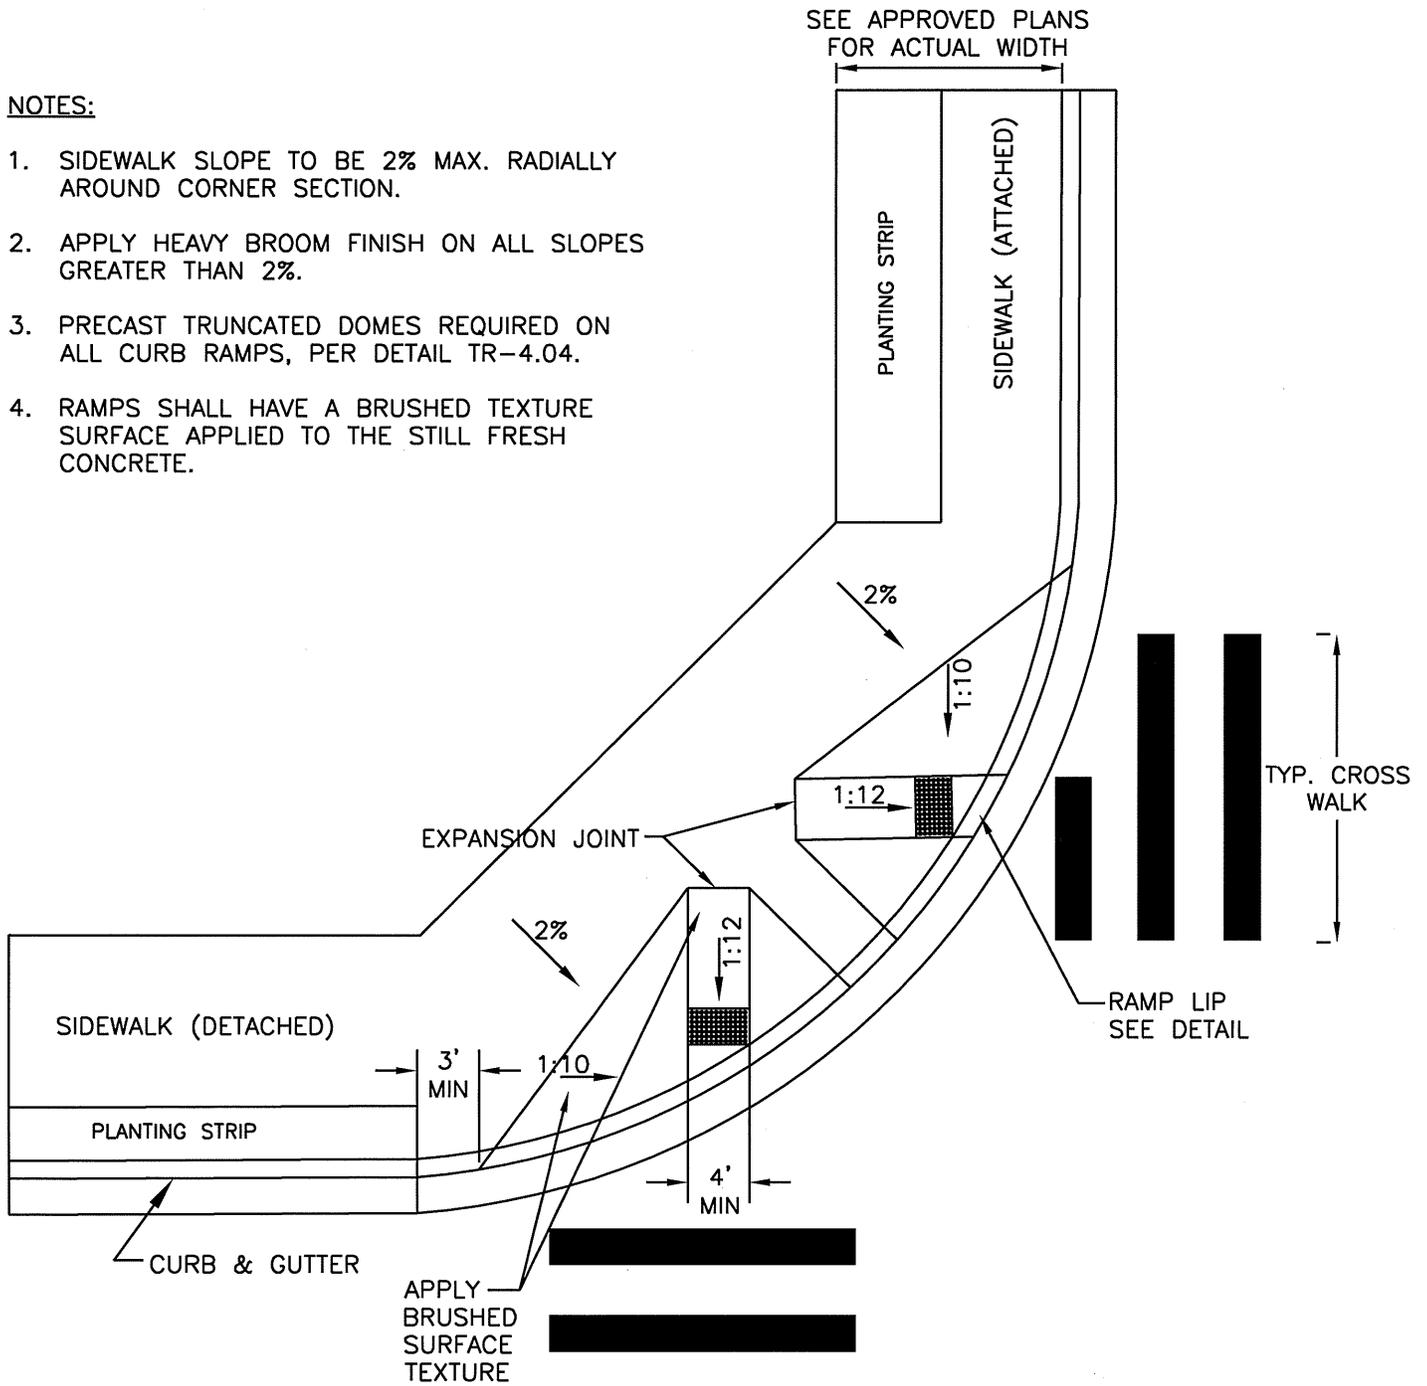

N.T.S.

TYPE 1A CURB RAMP

PLAN #



CITY OF BATTLE GROUND
APPROVED

Rl w
6/6/08
CITY ENGINEER DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	8/12/98	BSG	GGH
2	6/6/08	ALL	MCH

TR-4.05