


SAWCUT AND REMOVE CURB FOR INSTALLATION AT EXISTING CURB AND GUTTER

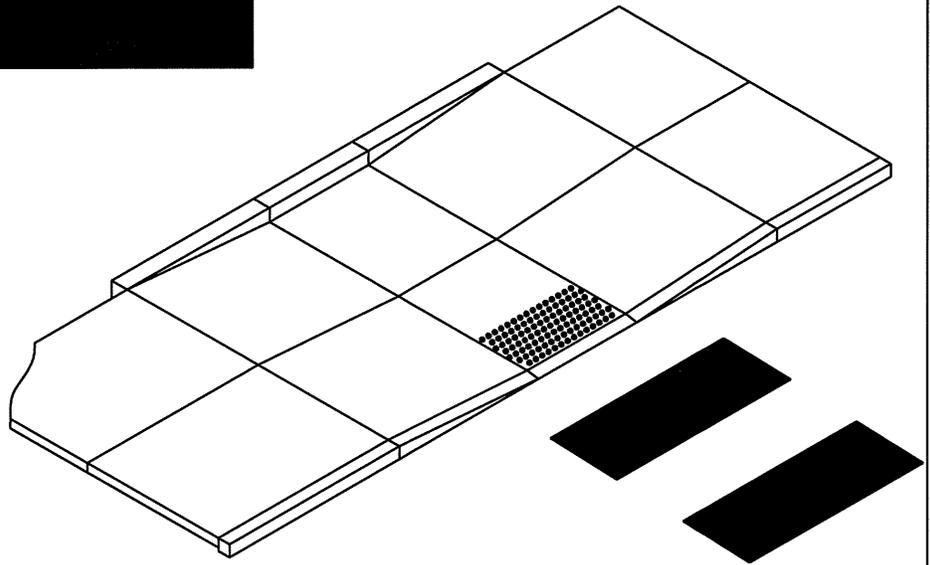

NOTES:

1. CURB RAMPS TO BE CENTERED WITHIN CROSSWALK.
2. APPLY HEAVY BROOM FINISH ON ALL SLOPES GREATER THAN 2%.
3. PRECAST TRUNCATED DOMES REQUIRED ON ALL CURB RAMPS, PER DETAIL TR-4.04.
4. RAMPS SHALL HAVE A BRUSHED TEXTURE SURFACE APPLIED TO THE STILL FRESH CONCRETE.

N.T.S.

TYPE 2B CURB RAMP

PLAN #



CITY OF BATTLE GROUND APPROVED

Rt W
 6/6/08
 CITY ENGINEER DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	8/12/98	BSG	GGH
2	8/30/05	ALL	MCH
3	6/6/08	JMH	MCH

TR-4.08