


SAWCUT AND REMOVE CURB RAMP FOR INSTALLATION AT EXISTING CURB AND GUTTER



NOTES:

1. CURB RAMPS TO BE CENTERED WITHIN CROSSWALK.
2. APPLY HEAVY BROOM FINISH ON ALL SLOPES GREATER THAN 2%.
3. PRECAST TRUNCATED DOMES REQUIRED ON ALL CURB RAMPS, PER DETAIL TR-4.04.
4. RAMPS SHALL HAVE A BRUSHED TEXTURE SURFACE APPLIED TO THE STILL FRESH CONCRETE.

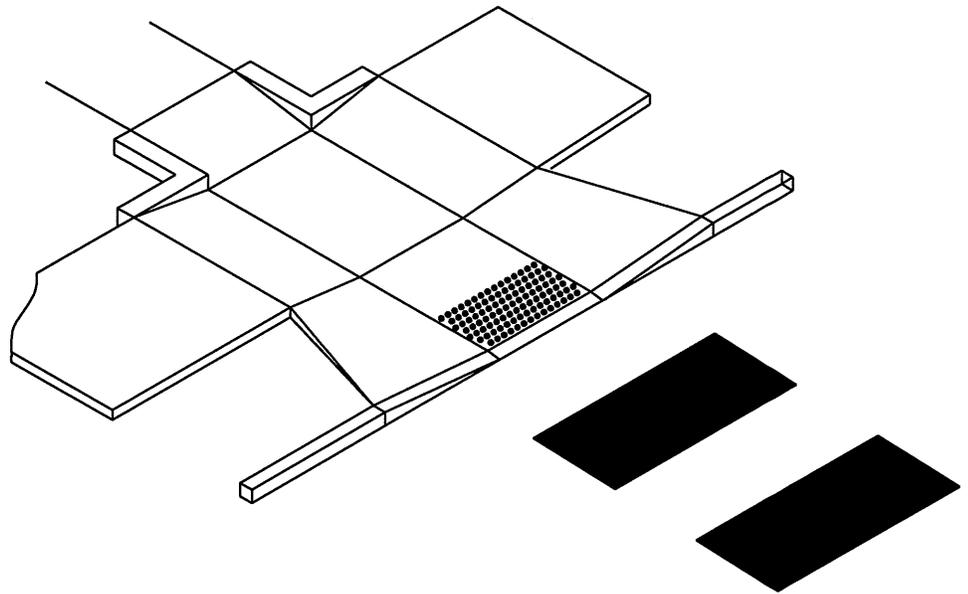

N.T.S.

TYPE 2C CURB RAMP

PLAN #



CITY OF BATTLE GROUND APPROVED

Rl
CITY ENGINEER 6/6/08
DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	3/24/06	CMS	MCH
2	1/17/08	JMH	MCH
3	6/6/08	JMH	MCH

TR-4.09