


NOTES:


1. EXISTING CURB AND SIDEWALK TO BE SAWCUT AND REMOVED FOR INSTALLATION OF NEW RAMPS.
2. RAMPS TO BE POURED SEPARATELY FROM SIDEWALK AND ISOLATED BY EXPANSION JOINT MATERIAL.
3. WING DIMENSIONS MAY VARY TO MEET REQUIRED SLOPE.
4. DOUBLE RAMPS ALLOWED ONLY IF RADIUS IS GREATER THAN OR EQUAL TO 25'.
5. IF THE AREA BEHIND THE SIDEWALK IS VEGETATED, THE BACK CURB MAY BE REPLACED WITH A SLOPE NO STEEPER THAN 4:1.

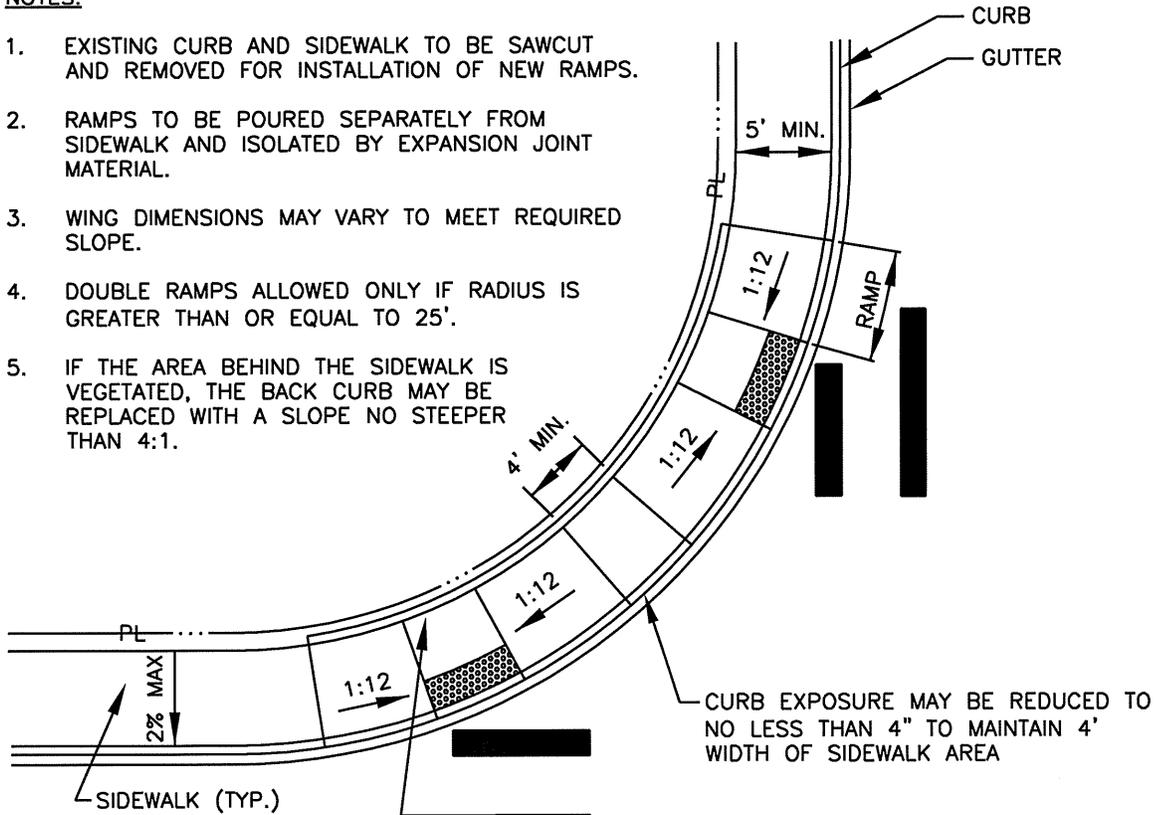

VERTICAL CURB TR-3.00
 OUTSIDE OF SIDEWALK (MAY BE
 INSTALLED INSIDE IF R.O.W. LINE
 IS BACK OF SIDEWALK)

IF THE MAXIMUM SLOPE OF 1:12 CANNOT BE ACHIEVED DUE TO THE SLOPE OF THE EXISTING SIDEWALK, THE LENGTH OF THE CURB RAMP SHALL NOT BE REQUIRED TO BE LONGER THAN 15 FEET REGARDLESS OF THE RESULTING RAMP SLOPE.

THIS TYPE OF RAMP IS ONLY TO BE USED IN EXISTING RESTRICTED RIGHT-OF-WAY AREAS AND WHEN APPROVED BY THE CITY ENGINEER.

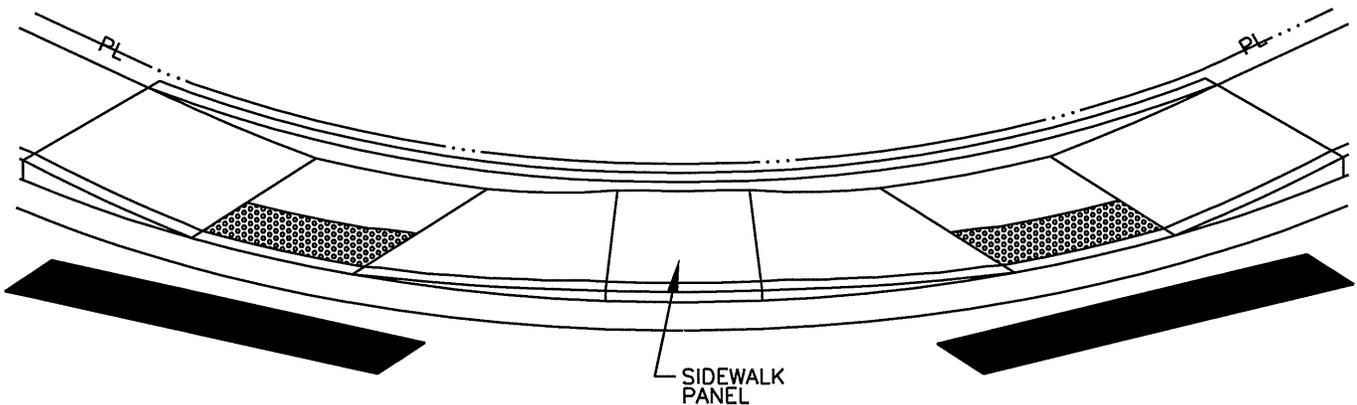

N.T.S.

TYPE 3B CURB RAMP

PLAN #



CITY OF BATTLE GROUND
 APPROVED

Rl w
 6/6/08
 CITY ENGINEER DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	5/31/08	JMH	MCH
2	6/6/08	JMH	MCH

TR-4.11