

PROPERTY  
LINE

5' MIN.

12" SLOPE  
ROUNDING (TYP.)

4" x 7 1/2" CONCRETE

1' EMBEDMENT


LEVEL

1/2" MIN.

NATIVE SOILS

6" MIN.

2" COMPOST TILLED  
INTO 6" TOPSOIL

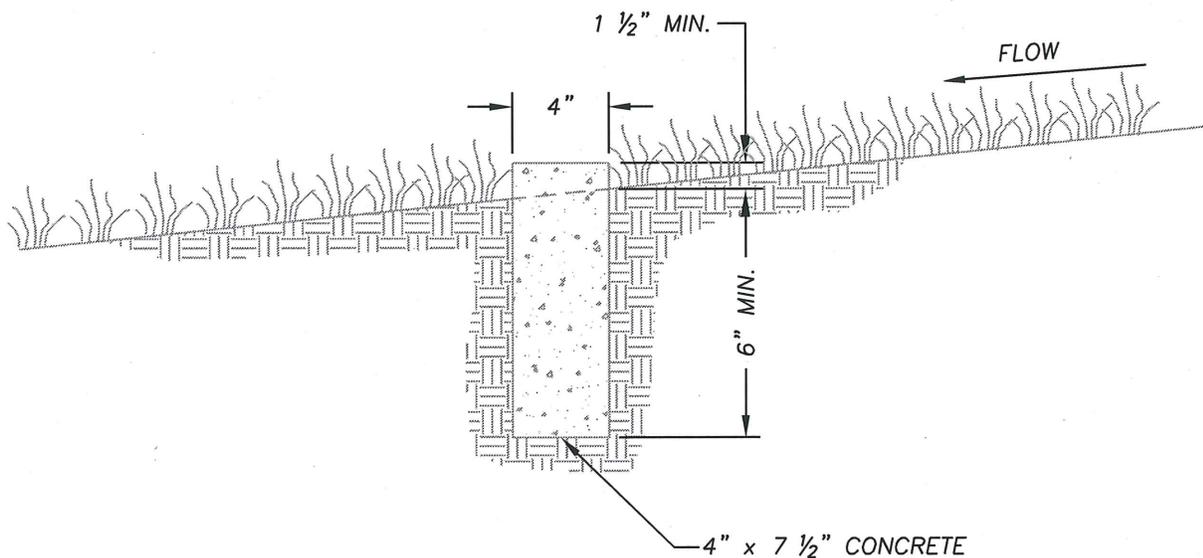


NOTES:

1. FLOW SPREADERS REQUIRED FOR SLOPES GREATER THAN 2.5% OR FOR SWALES WHICH EXCEED 100' IN LENGTH. FLOW SPREADERS TO BE INSTALLED IN A MAXIMUM OF 50' INTERVALS. THE SPREADER SHALL BE INSTALLED LEVEL AND ON CONTOUR, SEE STD. DETAIL ST-6.3.
2. CONCRETE SHALL BE 3000 PSI MIN. MEETING WSDOT STANDARD SPECIFICATIONS 6-02.3(2)B.

N.T.S.

FLOW SPREADER

STANDARD  
DETAIL



CITY OF BATTLE GROUND  
APPROVED

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	7/22/09	RMJ	RMJ

ST-6.3

*Scott P. Sawyer* 7-21-09  
CITY ENGINEER DATE