


CORRUGATED POLYETHYLENE

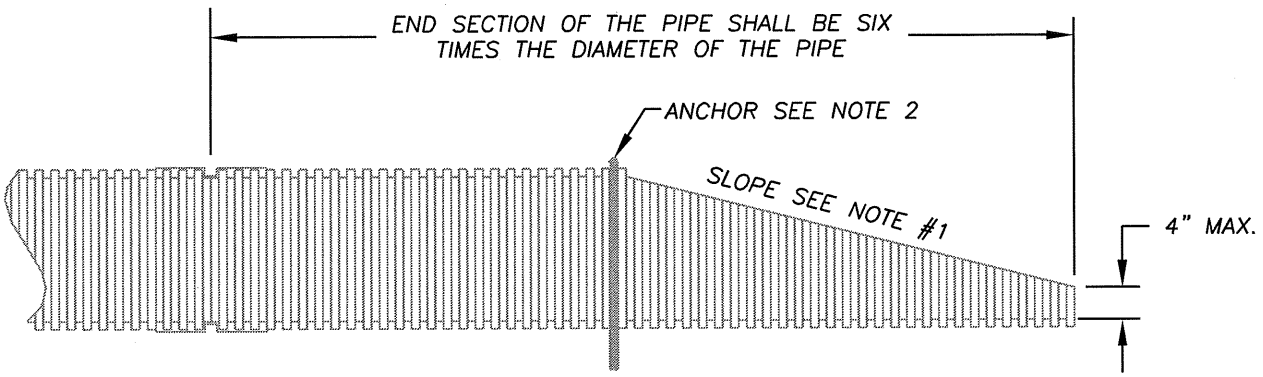


DUCTILE IRON OR CONCRETE PIPE

NOTES:

1. THE CULVERT ENDS SHALL BE BEVELED TO MATCH THE EMBANKMENT OR DITCH SLOPE, WITHOUT EXCEEDING THE LIMITS SHOWN ON THE PLAN. SLOPE FOR BEVELED EDGE SECTION SHALL MATCH BANK SIDE SLOPE UP TO A MAX. OF 3:1.
2. THE END OF CORRUGATED POLYETHYLENE SHALL BE ANCHORED. SEE STD. DETAIL ST-7.3.
3. FOR PIPES 15" OR LARGER, TRASH SCREEN REQUIRED. SEE STD. DETAIL ST-6.6.

N.T.S.
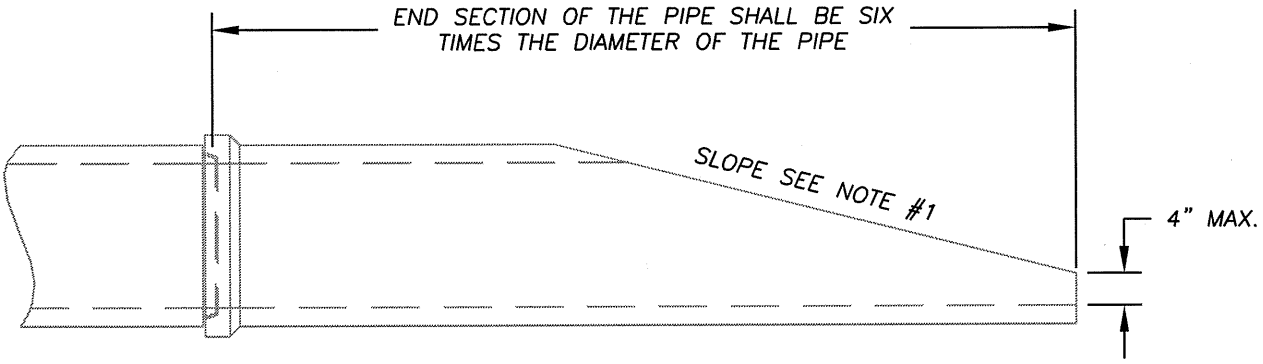
# BEVELED END SECTION

STANDARD DETAIL

THE CITY OF BATTLE GROUND

CITY OF BATTLE GROUND
APPROVED

Scott P. Sawyer 7-21-09
CITY ENGINEER DATE

| REVISIONS: | DATE: | DRAWN: | DESIGNED: |
|---|---|---|---|
| 1 | 7/22/09 | RMJ | RMJ |

ST-6.5