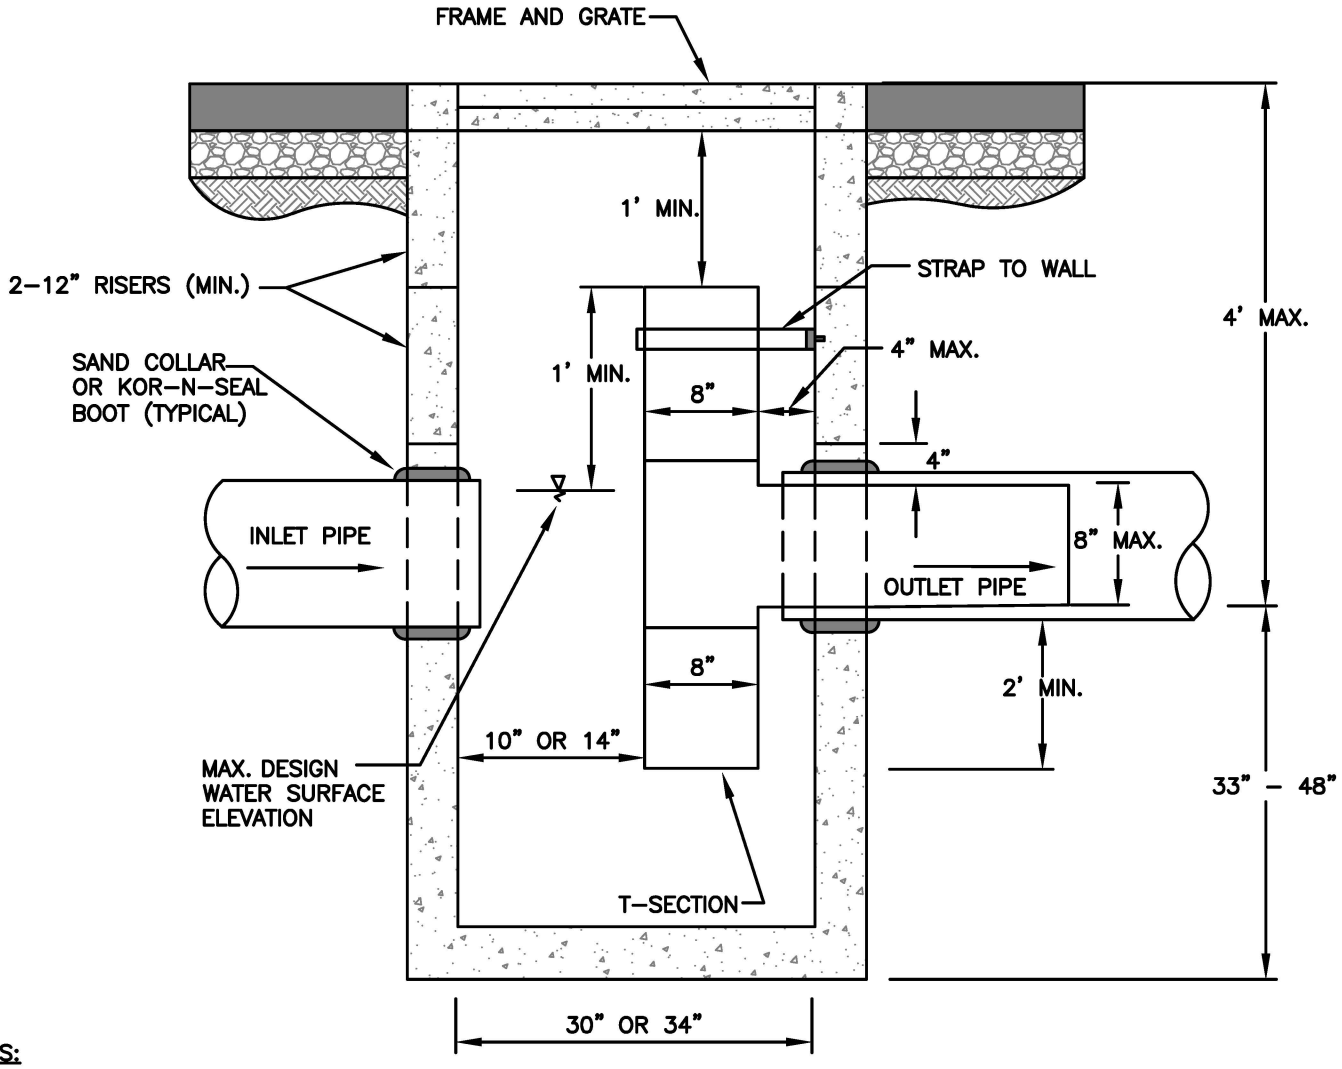


NOTES:

1. MAX. OUTLET PIPE DIAMETER IS 8 INCHES. VERTICAL RISER SECTION SHALL BE ALIGNED PLUMB VERTICALLY. HORIZONTAL RISER SECTION SHALL MATCH OUTLET PIPE SLOPE.
2. ALL METAL PARTS AND SURFACES MUST BE CORROSION RESISTANT. STEEL HARDWARE SHALL BE GALVANIZED. PIPES SHALL BE GALVANIZED, ASPHALT COATED (TREATMENT_1) OR ALUMINIZED. COMPLETE CORROSION PROTECTION MUST BE ASSURED.
3. APPLY NON–SHRINK GROUT TO INSIDE AND OUTSIDE OF ALL JOINTS, RINGS, RISERS AND FRAMES.
4. PENETRATE CARRIER PIPE THROUGH WALL.
5. USE APPROVED WATERTIGHT STRUCTURE ADAPTOR.
6. SLIP SMOOTH–BORE HORIZONTAL LEG OF FLOW CONTROL TEE INSIDE CARRIER PIPE.
7. NOT FLOW CONTROL JOINT OUTSIDE OF STRUCTURE.
8. SEE VOLUME V OF THE STORMWATER MANAGEMENT MANUAL FOR WESTERN WASHINGTON FOR MORE INFORMATION.

N.T.S.

SPILL CONTROL (SC) SEPARATOR

STANDARD DETAIL

THE CITY OF BATTLE GROUND

CITY OF BATTLE GROUND
APPROVED

Mark Henrey

06/11/2018

CITY ENGINEER DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	12/29/16	KDU	KDU
2	4/12/17	CAS	KDU

ST–3.06