
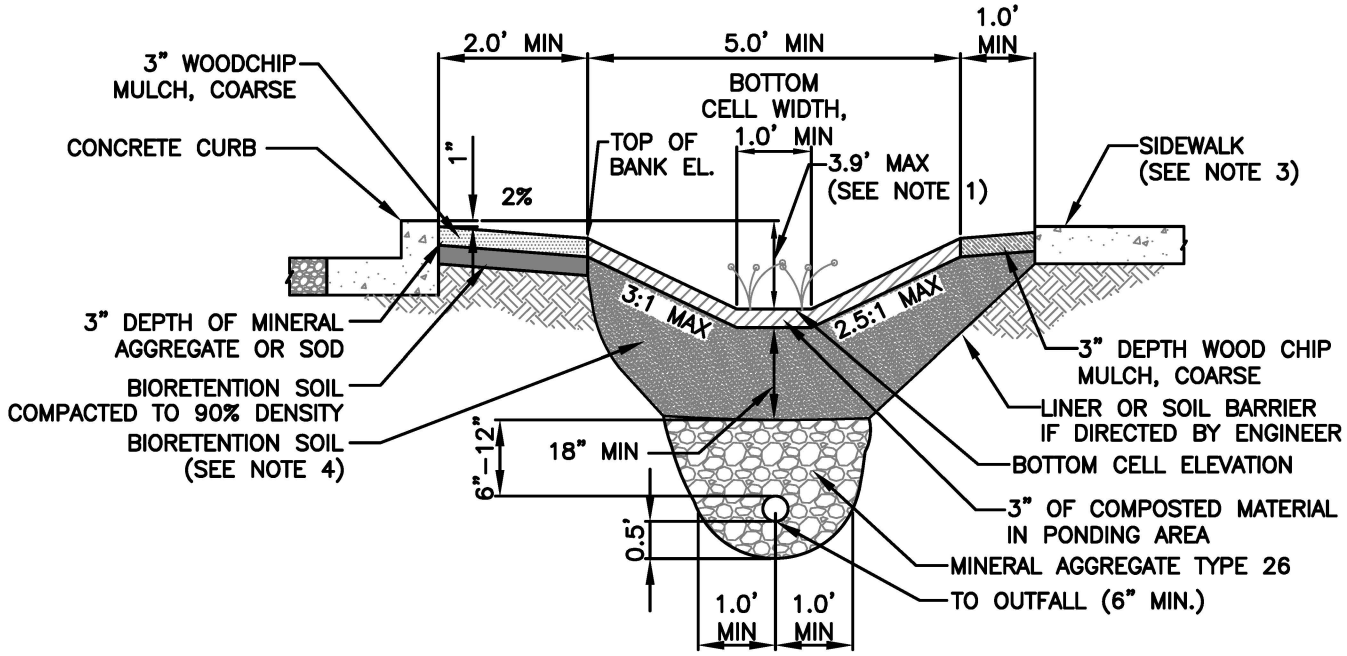


NOTES:

1. DEPTH OVER 4' REQUIRES GUARD RAIL.
2. 4:1 MAX WHEN WITHIN 50–FEET OF INTERSECTIONS.
3. SIDEWALK ELEVATION MUST BE SET ABOVE OVERFLOW ELEVATIONS.
4. SCARIFY SUBGRADE 3" MIN. BEFORE BIORETENTION SOIL INSTALLATION.
5. BIORETENTION SOIL MIXTURE SHOULD BE COMPACTED TO 85% PER ASTM 1577.

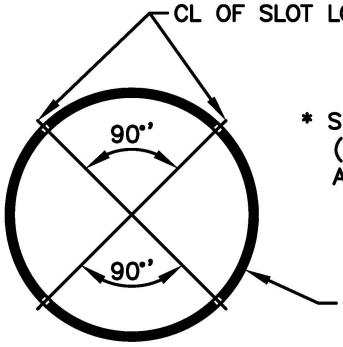

* SLOTS ARE TO BE 0.064" WIDE (ON 45° CENTERS) BY 1.0" LONG AND SPACED 0.3" APART.

SSD SLOT DETAIL

N.T.S.

BIORETENTION CELL SECTION WITH CURB

STANDARD DETAIL

CITY OF BATTLE GROUND
APPROVED

Mark Henry 06/11/2018

CITY ENGINEER DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	12/29/16	KDU	KDU
2	02/15/17	CAS	KDU

ST–11.04