
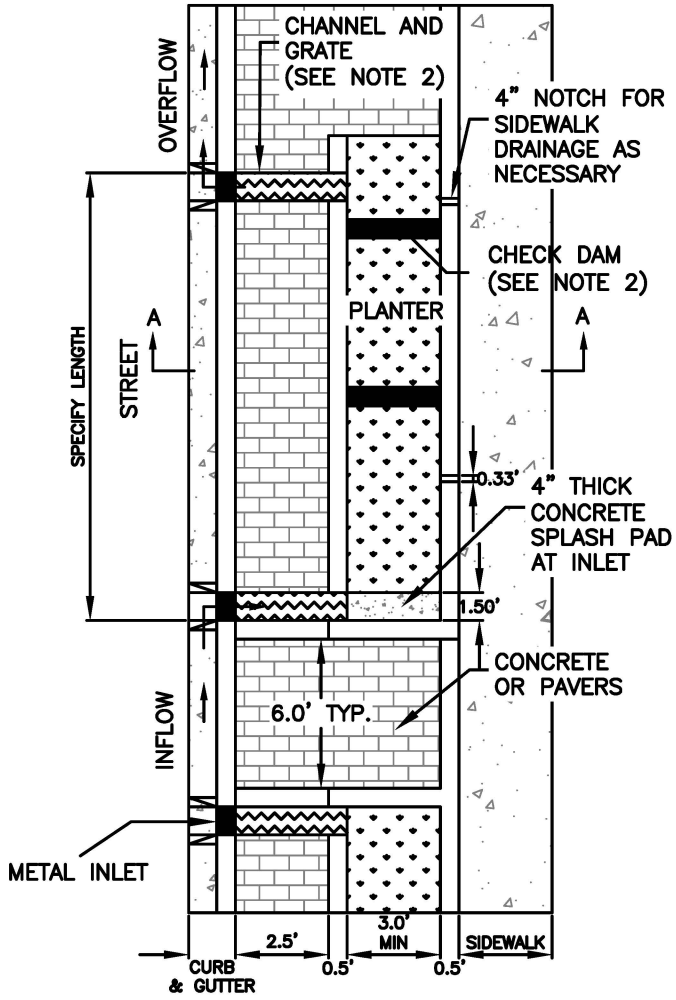


DESIGNER INFORMATION

1. ADAPT PLAN VIEW EXAMPLE TO ENGINEERED DESIGN.
2. INCLUDE BEGINNING AND ENDING STATIONS FOR EACH FACILITY. PROVIDE STATIONS AND/OR DIMENSIONS AND ELEVATIONS AT EVERY INLET, OUTLET, CHECK DAM, PLANTER CORNERS AND SIDEWALK NOTCH.
3. LONGITUDINAL SLOPE OF PLANTER MATCHES ROAD.
4. SIDEWALK ELEVATION MUST BE SET ABOVE INLET AND OUTLET TO DRAIN TO STREET BEFORE SIDEWALK.
5. MINIMUM INTERIOR PLANTER WIDTH IS 3 FEET. A MINIMUM 4 FEET INTERIOR PLANTER WIDTH IS REQUIRED FOR STREET TREES IN PLANTER.
6. EXISTING UTILITY LINES MUST BE SLEEVED OR RELOCATED. PROPOSED UTILITY LINES TO BE LOCATED OUT OF THE FACILITY.
7. AREA AND DEPTH OF FACILITY ARE BASED UPON ENGINEERING CALCULATION AND RIGHT-OF-WAY CONSTRAINTS.
8. MAY USE CONCRETE OR PAVERS.
9. REFER TO BMP T7.30 IN VOLUME V OF THE STORMWATER MANAGEMENT MANUAL FOR WESTERN WASHINGTON FOR MORE INFORMATION.

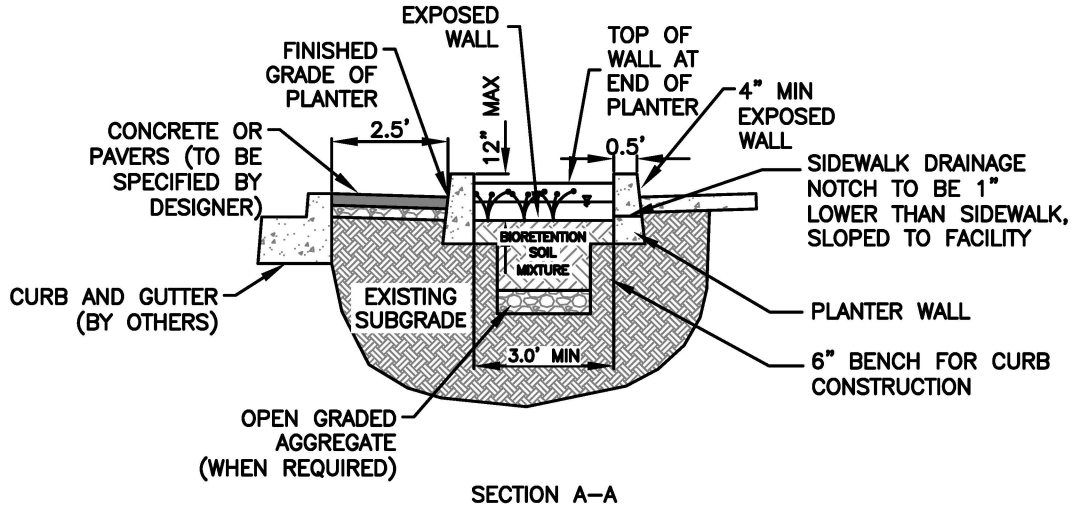

SECTION A-A

N.T.S.

BIORETENTION PLANTER

STANDARD DETAIL

CITY OF BATTLE GROUND APPROVED

Mark Hensley 06/11/2018

CITY ENGINEER DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	12/29/16	KDU	KDU
2	02/15/17	CAS	KDU

ST-11.05