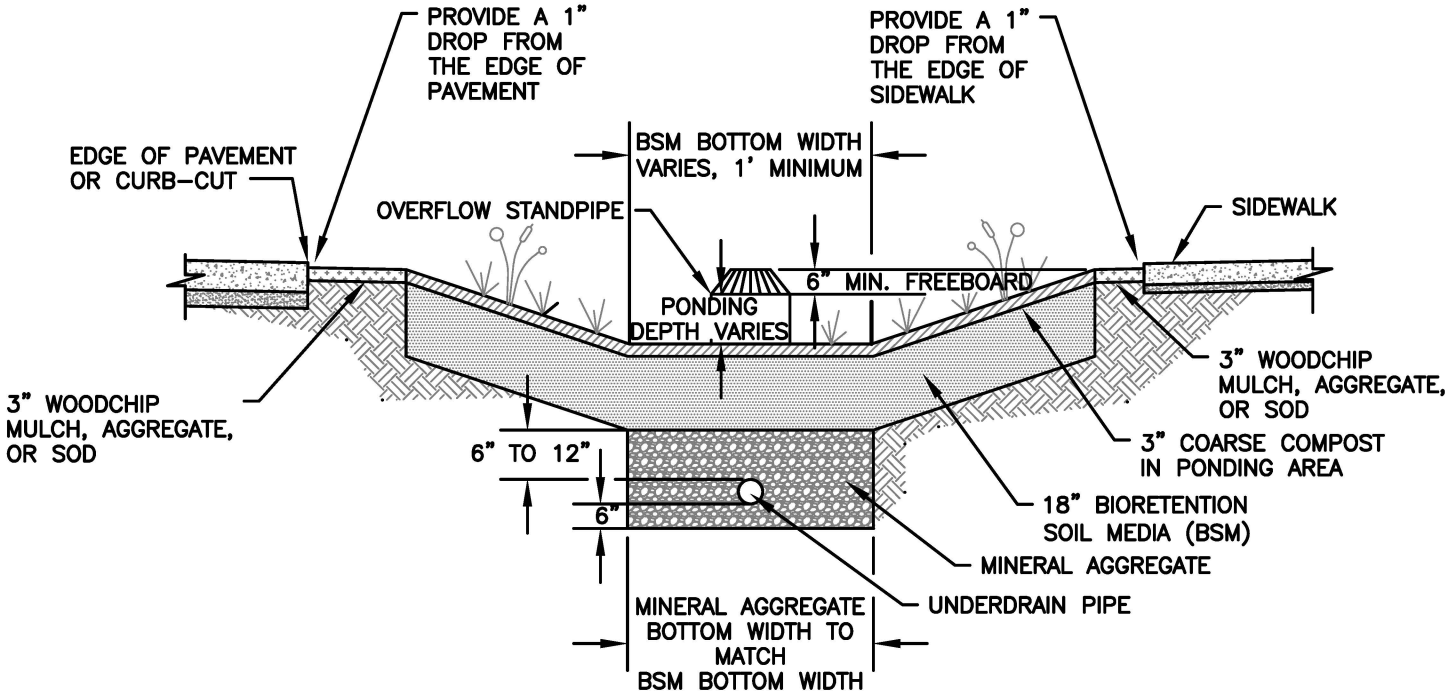


NOTES:

1. SCARIFY SUBGRADE 3" MIN. BEFORE BIORETENTION SOIL INSTALLATION.
2. COMPACT BSM TO 85% PER ASTM 1577.
3. REFER TO BMP T7.30 IN VOLUME V OF THE STORMWATER MANAGEMENT MANUAL FOR WESTERN WASHINGTON FOR MORE INFORMATION.

N.T.S.

BIORETENTION WITH UNDERDRAIN

STANDARD DETAIL

THE CITY OF BATTLE GROUND

CITY OF BATTLE GROUND
APPROVED

Mark Henrey 06/11/2018

CITY ENGINEER DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	01/23/16	KDU	KDU
2	02/16/17	CAS	KDU

ST–11.07