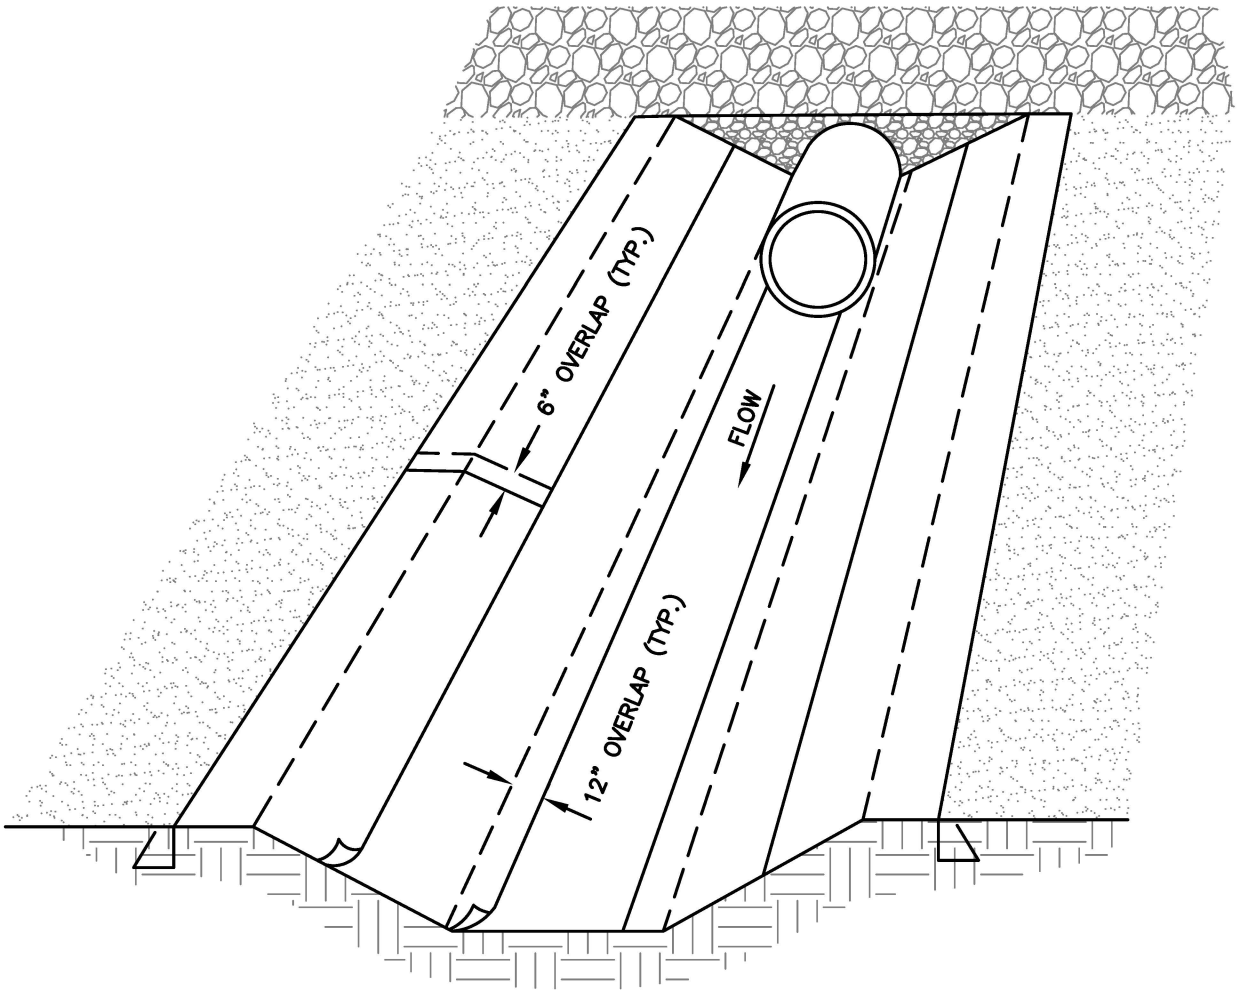


NOTES:

1. INFORMATION PROVIDED IS MINIMUM REQUIREMENTS. MANUFACTURER'S REQUIREMENTS SHALL BE USED IF MORE STRINGENT.
2. INSTALL MAT PARALLEL IN CENTER OF CHANNEL IN THE DIRECTION OF FLOW. FOR CULVERT OUTFALLS, PLACE MAT UNDER CULVERT OR RIP RAP A MIN. OF 12".
3. IN CHANNEL BOTTOM, OVERLAP LENGTH ENDS A MINIMUM OF 12".
4. REFER TO STD. DETAIL EC-1.01 FOR MATTING NOTES.
5. REFER TO BMP C122 IN VOLUME II OF THE STORMWATER MANAGEMENT MANUAL FOR WESTERN WASHINGTON FOR MORE INFORMATION.

N.T.S.

NETS AND BLANKETS

STANDARD DETAIL

THE CITY OF BATTLE GROUND

CITY OF BATTLE GROUND
APPROVED

Mark Henrey 06/11/2018

CITY ENGINEER DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	9/15/10	RMJ	RMJ
2	3/13/17	CAS	KDU

EC-7.00