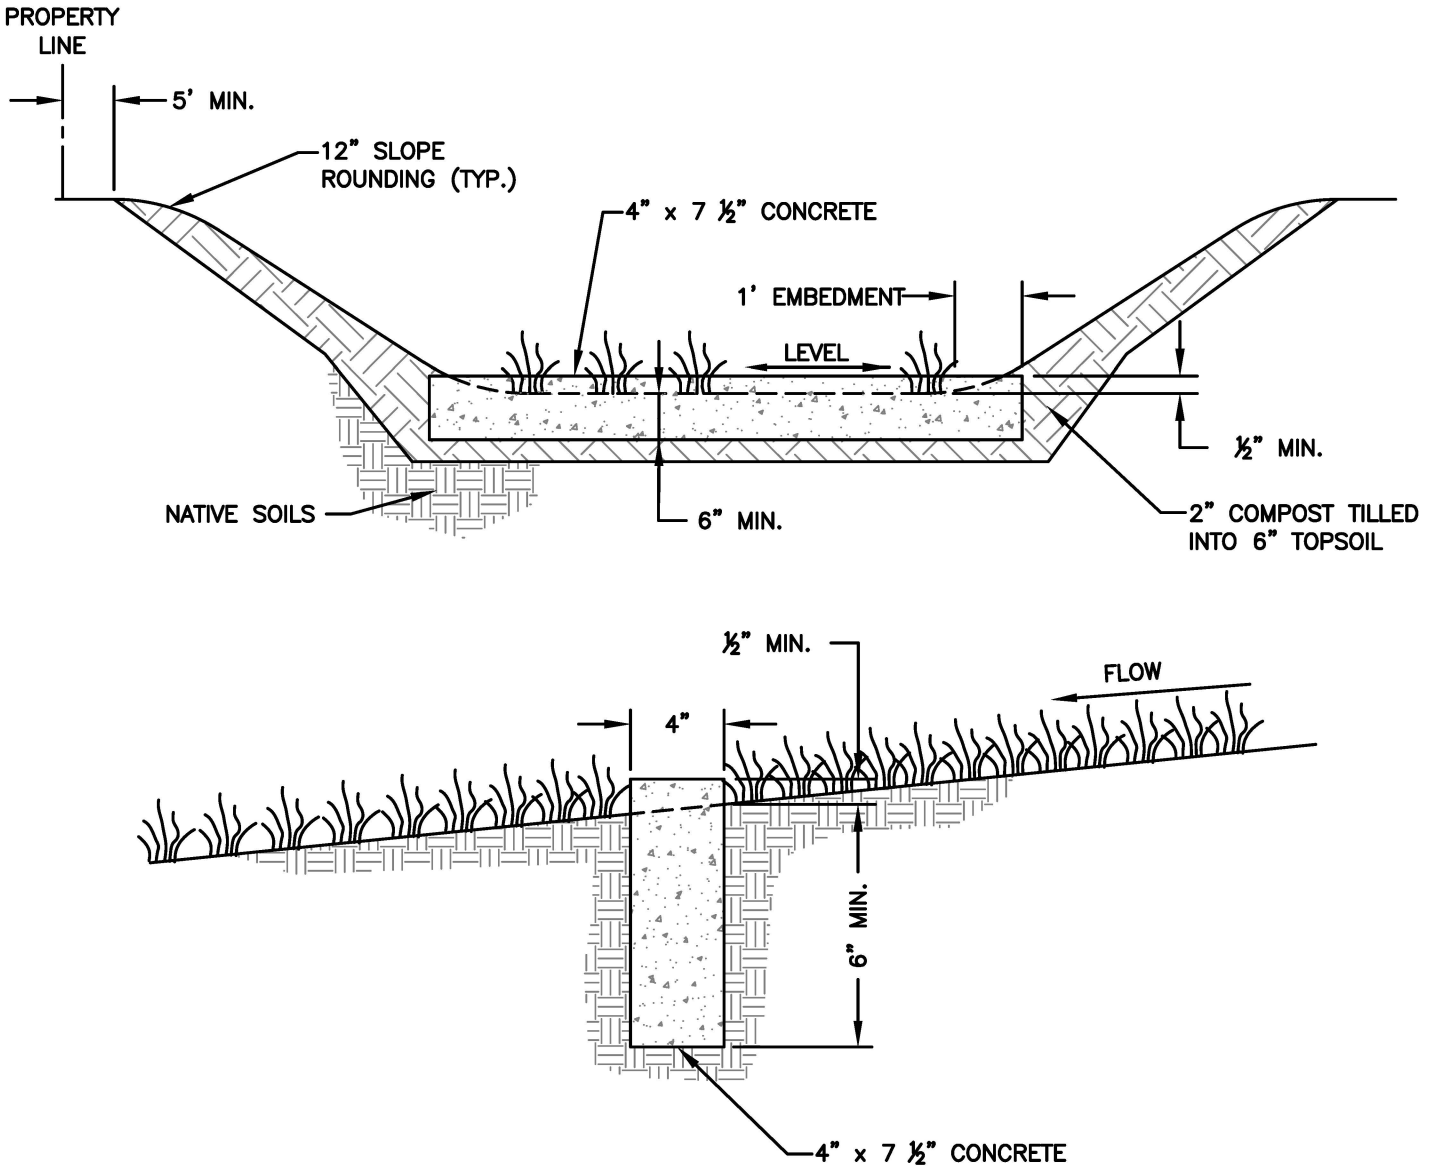


NOTES:

1. FLOW SPREADERS REQUIRED FOR SLOPES GREATER THAN 2.5% OR FOR SWALES WHICH EXCEED 100' IN LENGTH. FLOW SPREADERS TO BE INSTALLED IN A MAXIMUM OF 50' INTERVALS. THE SPREADER SHALL BE INSTALLED LEVEL AND ON CONTOUR.
2. CONCRETE SHALL BE 3000 PSI MIN. MEETING WSDOT STANDARD SPECIFICATIONS 6-02.3(2)B.

N.T.S.

FLOW SPREADER

STANDARD DETAIL

THE CITY OF BATTLE GROUND

CITY OF BATTLE GROUND
APPROVED

Mark Henrey

06/11/2018

CITY ENGINEER DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	7/22/09	RMJ	RMJ
2	3/31/17	CAS	KDU

ST-6.03