

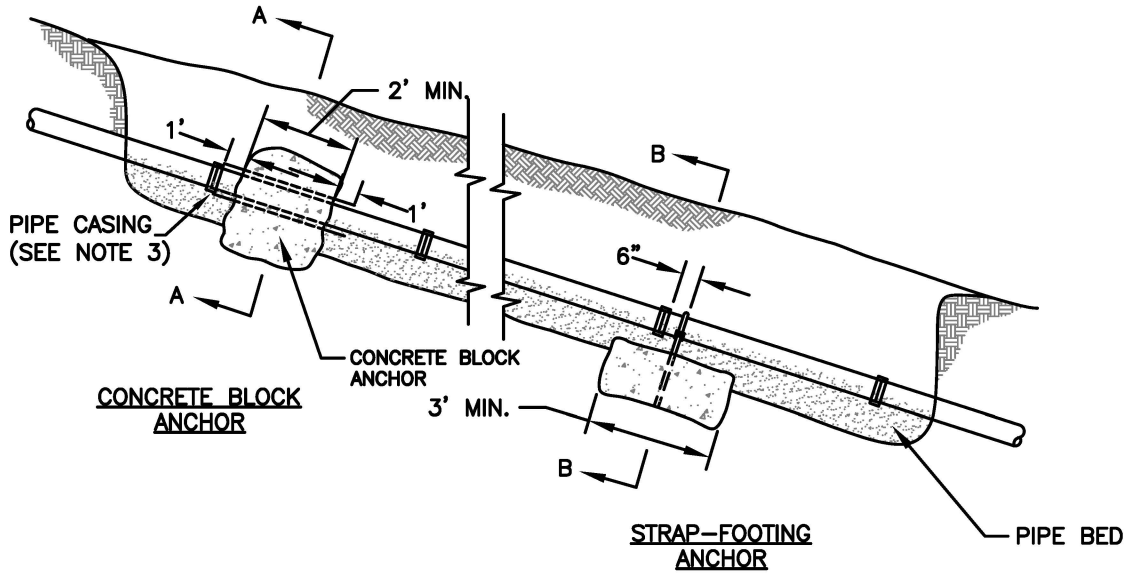


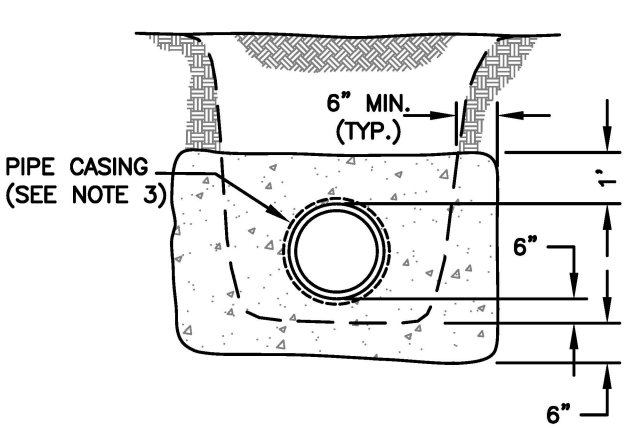

SECTION A–A

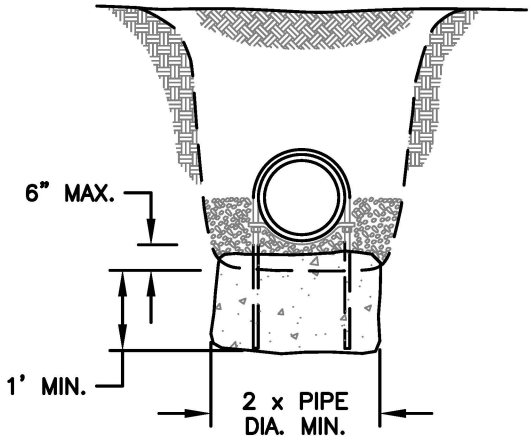

SECTION B–B

NOTES:

1. CONCRETE SHALL BE 3000 PSI MIN. MEETING WSDOT STANDARD SPECIFICATIONS 6–02.3(2)B.
2. CONCRETE SHALL BE POURED AGAINST FORMS OR STABLE UNDISTURBED SOIL.
3. FOR HDPE, PIPE MUST BE FREE TO SLIDE INSIDE A 4' (MIN.) LONG SECTION OF PIPE ONE SIZE DIAMETER LARGER.
4. ANCHORS TO BE USED WHERE GRADE IS 20% OR GREATER. MINIMUM SPACING AS FOLLOWS:
   NOT OVER 36' CENTER TO CENTER ON GRADES OF 20% AND UP TO 35%
   NOT OVER 24' CENTER TO CENTER ON GRADES OF 35% AND UP TO 50%
   NOT OVER 16' CENTER TO CENTER ON GRADES OF 50% AND MORE

N.T.S.

PIPE ANCHOR

STANDARD DETAIL

CITY OF BATTLE GROUND
APPROVED

Mark Hennes 06/11/2018

CITY ENGINEER DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	7/22/09	RMJ	RMJ
2	4/6/17	CAS	KDU

ST–7.03