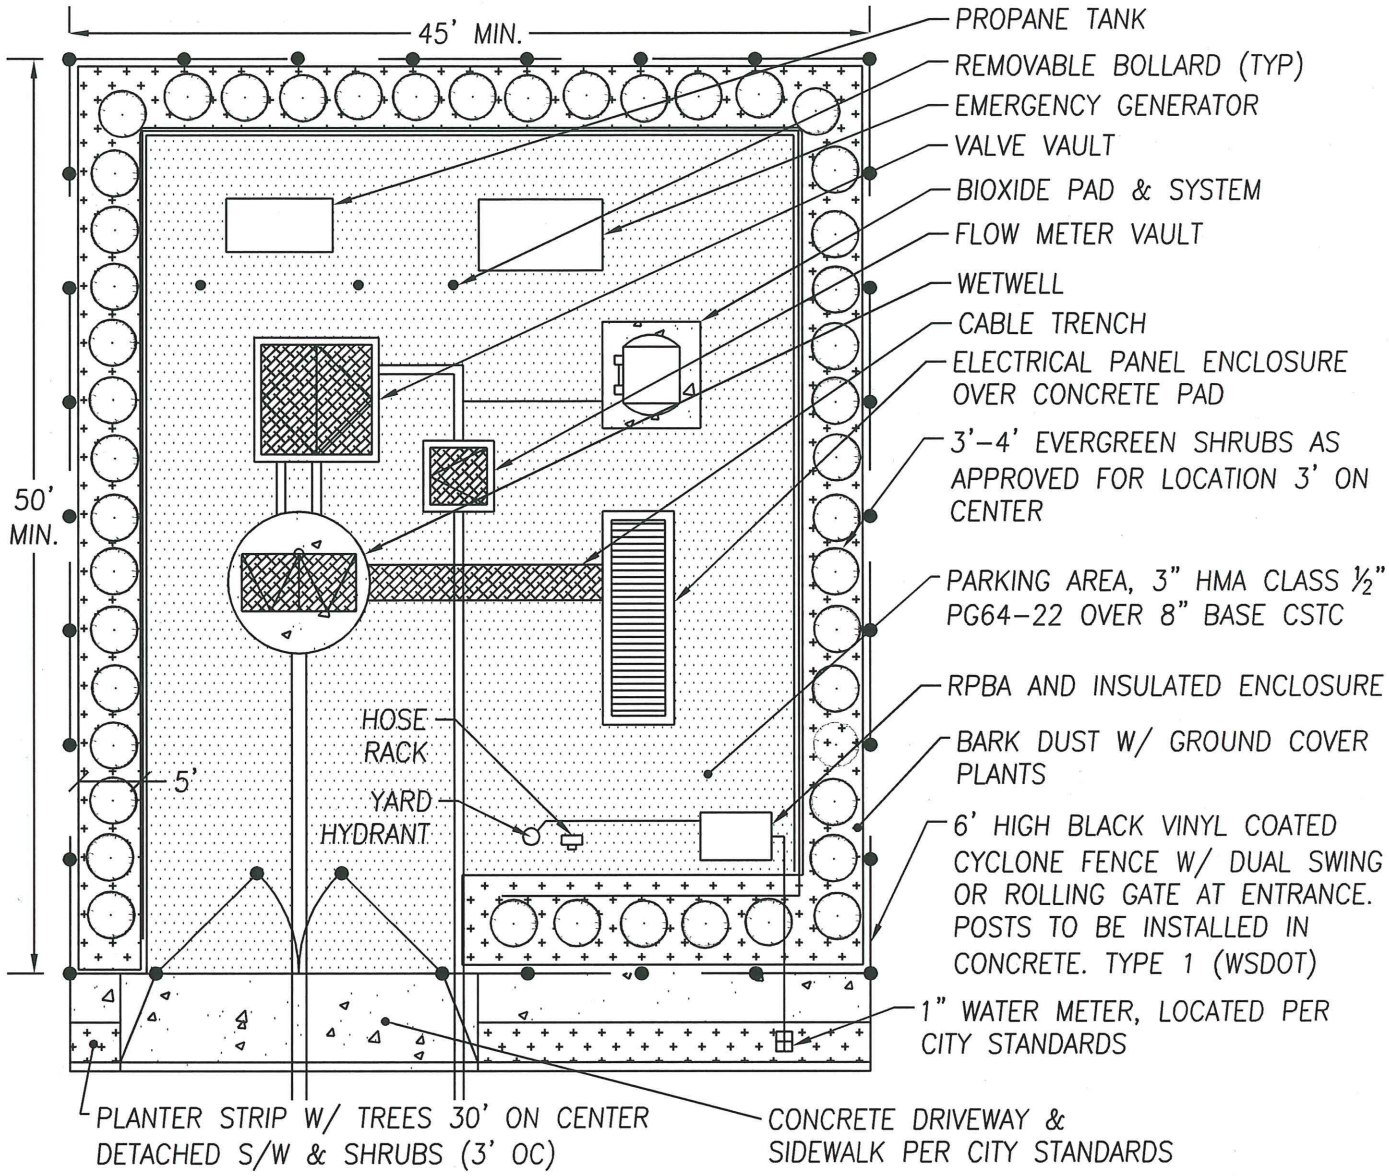


NOTES:

1. BARK DUST AREA – PLACE WEED BARRIER FABRIC UNDER BARK DUST TO CONTROL WEEDS.
2. ELECTRICAL STRUCTURE PAD, TERMINAL VAULT LID, WETWELL COVER, GENERATOR PAD, AND VALVE VAULT COVER SHALL BE SET AT THE SAME ELEVATION WITH 4" CLEARANCE TO THE ASPHALT.
3. SITE TO BE ADJUSTED TO MEET ALL SETBACK REQUIREMENTS AS NEEDED.
4. STATION TO BE PLACED ON A TRACT DEDICATED TO THE CITY OF BATTLE GROUND.
5. THIS PLAN SHOWS MINIMUM LANDSCAPING AND SCREENING REQUIREMENTS. ENGINEERS ARE ENCOURAGED TO USE IT AS A GUIDE AND ARE REQUIRED TO SUBMIT A SPECIFIC SITE PLAN FOR REVIEW. ADEQUATE LANDSCAPING IS REQUIRED TO MINIMIZE PUMP STATION IMPACT AND INTRUSION INTO BORDERING NEIGHBORHOOD. LARGER SITES MAY BE REQUIRED, WHEN ACCESS IS OFF OF AN ARTERIAL, TO ALLOW MAINTENANCE VEHICLES TO TURN AROUND ON THE SITE.

PUMP STATION SITE PLAN

PLAN #

THE CITY OF BATTLE GROUND

CITY OF BATTLE GROUND
APPROVED

3-28-07

CITY ENGINEER DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	8/12/98	BSG	GGH
2	8/30/05	ALL	MCH
3	3/28/07	JMH	MCH

SS-6.0

N:\CAD Data\Standard Dwgs\Sanitary Sewer Details\SS-6.0_Site Plan.dwg, 3/28/2007 2:16:39 PM