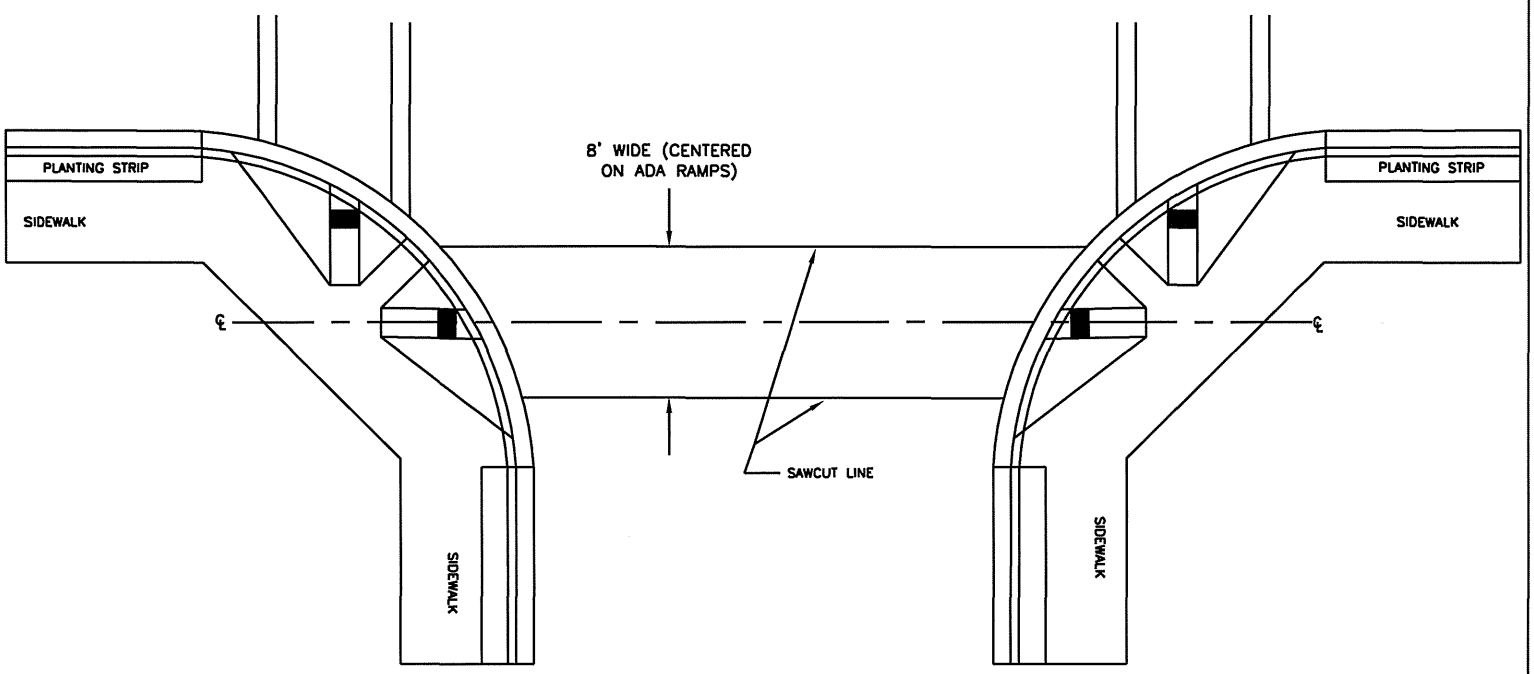


NOTES:

1. CONCRETE TO BE PLACED AT FINAL GRADE.
2. CONCRETE TO BE 3000 PSI MEETING WSDOT STANDARD SPECIFICATIONS 6-02.3(2)B AND A MINIMUM OF 8" THICK WITH THICKNESS OF BASE ROCK EQUAL TO THE THICKNESS OF BASE ROCK UNDER THE ASPHALT.
3. INSTALL #3 REBAR AT 18" MAX SPACING IN BOTH DIRECTIONS.

N.T.S.

CONCRETE CROSSWALK

PLAN #

THE CITY OF BATTLE GROUND

CITY OF BATTLE GROUND
APPROVED

6/9/08

CITY ENGINEER DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	6/9/08	JMH	MCH

TR-6.10