

SINGLE-FAMILY WATER METER INSTALLATION LOCATION

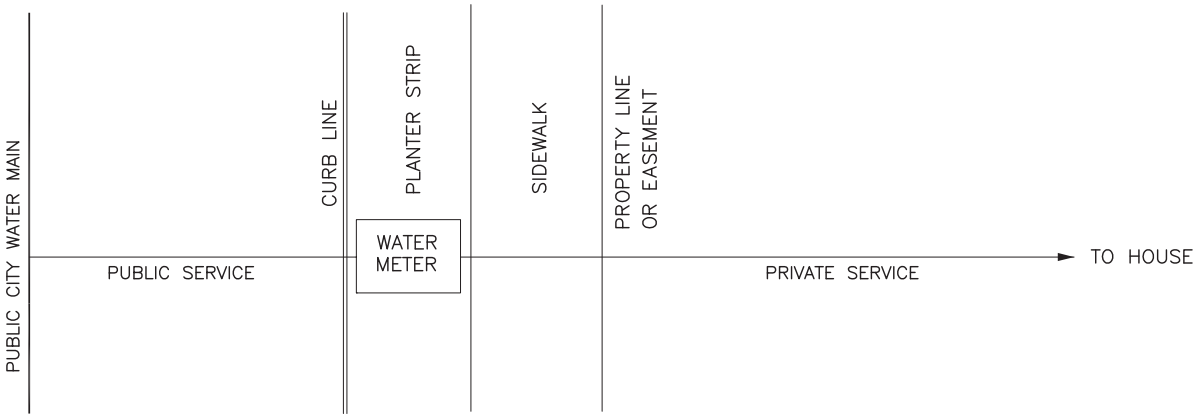

SINGLE-FAMILY WATER METER/DCVA LOCATION FOR IRRIGATION LINE INSTALLATION

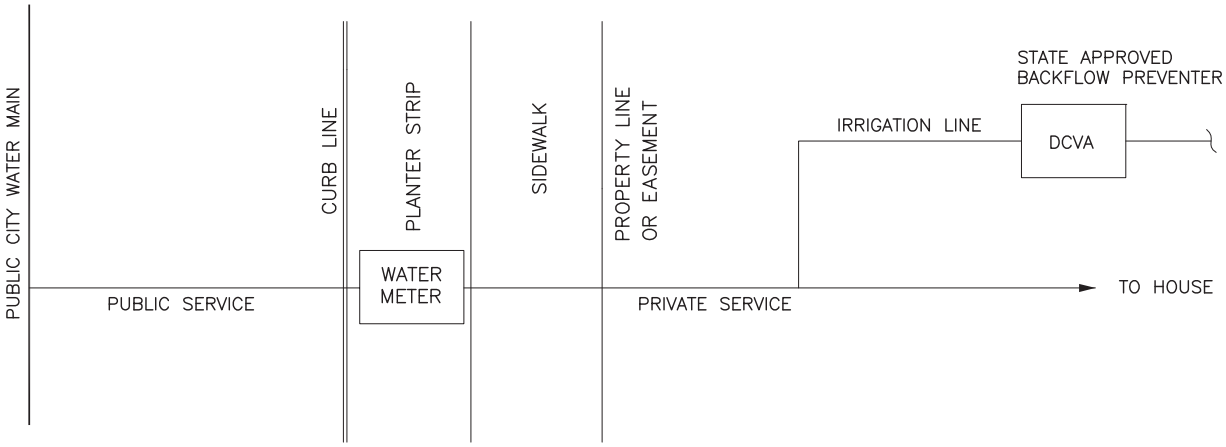

NOTES:

1. DOMESTIC SERVICES SHALL BE TAPPED FROM MAIN LINES AND NOT FROM FIRE PROTECTION AND OR HYDRANT LINES.
2. AN IRRIGATION PERMIT FROM THE CITY OF BATTLE GROUND IS REQUIRED FOR ALL IRRIGATION SYSTEMS.
3. ALL BACKFLOW DEVICES ARE PRIVATELY OWNED AND MAINTAINED. BACKFLOW DEVICES MUST BE TESTED ANNUALLY BY A CERTIFIED BACKFLOW ASSEMBLY TESTER.
4. ALL IRRIGATION SYSTEMS ARE REQUIRED TO BE EQUIPPED WITH A DOUBLE CHECK VALVE ASSEMBLY (DCVA). ABOVE GROUND ATMOSPHERIC VACUUM BREAKERS (AVB'S) ARE NOT ALLOWED FOR BACKFLOW PREVENTION.

SINGLE-FAMILY WATER METER/BACKFLOW INSTALLATION LOCATIONS

PLAN #

THE CITY OF BATTLE GROUND

CITY OF BATTLE GROUND
APPROVED

Ryan M. Jaynes 1/18/24
CITY ENGINEER DATE

REVISIONS:	DATE:	DRAWN:	DESIGNED:
1	4/16/07	JMH	MCH
2	9/24/07	MCH	MCH
3	5/6/21	RMJ	RMJ
4	1/18/24	RMJ	RMJ

WA-6.1